


# SPECIFICATION SHEET NOFIRNO BOARD & ACTIFOAM - CABLES - LIGHT WEIGHT

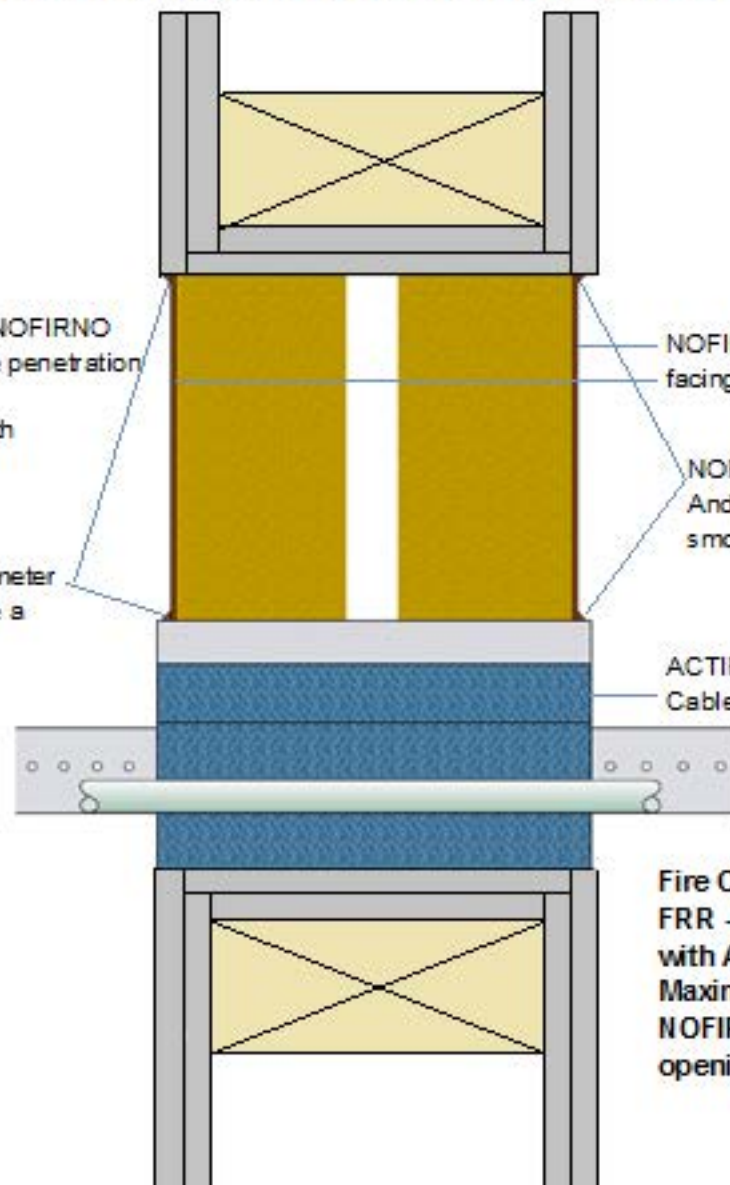

Two layers of single side coated NOFIRNO Board panels installed to oversize penetration

A NOFIRNO Board coated on both sides installed as a single panel will achieve a -/60/60 FRR

NOFIRNO sealant applied to perimeter And joins on both sides to achieve a smoke tight seal

NOFIRNO coating on surface facing outwards on both sides

NOFIRNO sealant applied to perimeter And joins on both sides to achieve a smoke tight seal

ACTIFOAM sheets installed around Cable tray and cables

10mm of NOFIRNO sealant must be applied to both sides of the ACTIFOAM and around the cables to achieve a smoke tight seal

**Fire Classification according to AS 4072.1-2005**

**FRR -/120/120 in 150mm thick partition tested in accordance with AS 1530.4-2005**

**Maximum aperture size 1800 x100 mm or equivalent to 18000cm<sup>2</sup>**

**NOFIRNO sealant must be applied to both sides of the conduit opening to achieve a smoke tight seal**